
NOTES:

- . ALL OPERATOR & NOZZLE NUTS SHALL BE $1 \frac{1}{2}$ " AND PENTAGONAL.
- 2. OPERATOR NOT TO OPEN COUNTER-CLOCKWISE.
- PROVIDE RESTRAIN BETWEEN ISOLATION VALVE AND HYDRANT BASE SHOE WITH APPROVED JOINT RESTRAINT.
- 4. PROVIDE A 5" "QUICK DISCONNECT" STORZ ADAPTER ON 41/2" PUMPER NOZZLE.

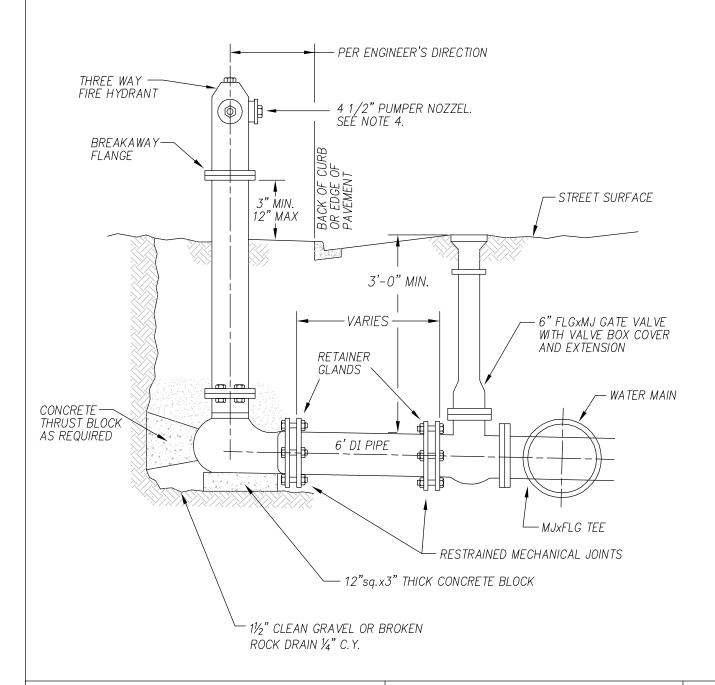

LAKE GROVE WATER DISTRICT WATER SYSTEM STANDARDS

DECEMBER, 2018

FIRE HYDRANT

LG 3