




WATER METER
1" SERVICE
SEE DETAIL #4

PLAN

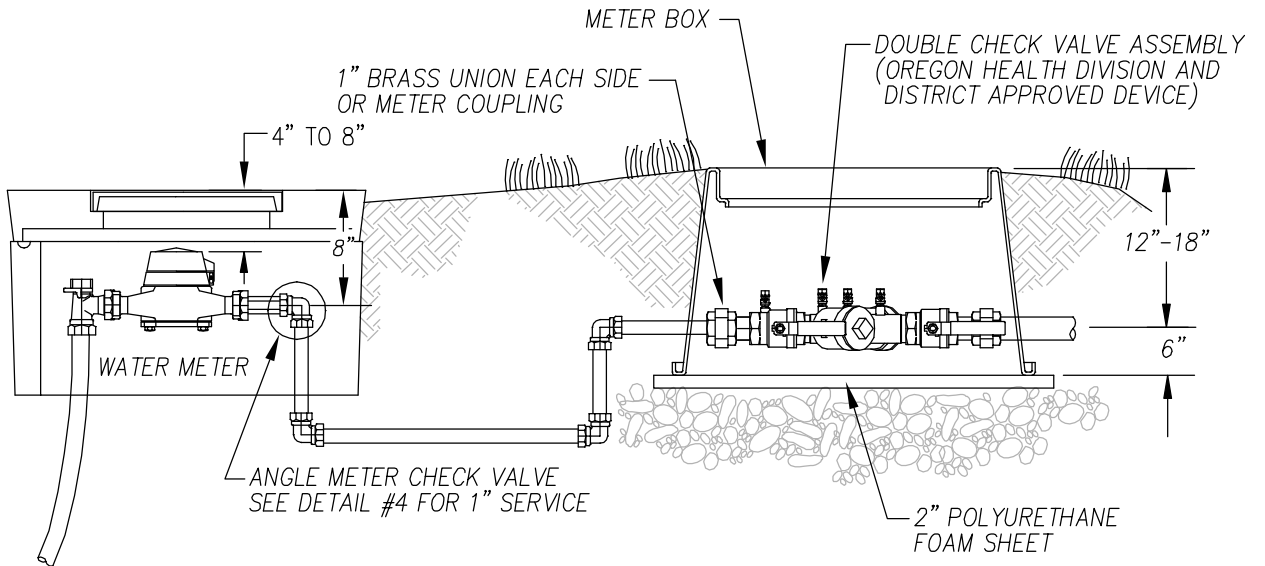

ELEVATION

BOX SPECIFICATIONS	
DEVICE SIZE	BOX TYPE
3/4" - 1"	BROOKS #4 SERIES OR EQUAL
1 1/2" - 2"	CARSON 1730D P15L OR EQUAL

NOTES:

1. DOUBLE CHECK TO BE LOCATED DIRECTLY BEHIND WATER METER.
2. BRASS, STAINLESS, OR PLASTIC PLUGS TO BE INSTALLED IN TEST COCKS IF BELOW GROUND INSTALLATION.
3. DISTANCE FROM BOTTOM OF DEVICE TO FINISH GRADE, FREEZE PROTECTION, AND CLEARENCE FOR TESTING AND REPAIR ARE THE MAJOR CONSIDERATIONS FOR INSTALLATION.
4. THE BACKFLOW LAYOUT IS CONCEPTUAL AND CAN BE MODIFIED AS NEEDED BY THE OWNER.