


VAULT SPECIFICATIONS

SIZE	MFG.
3/4" - 1"	UTILITY VAULT 3030-LA (OR EQUAL)
1 1/2" - 2"	UTILITY VAULT 3642-PUT (OR EQUAL)

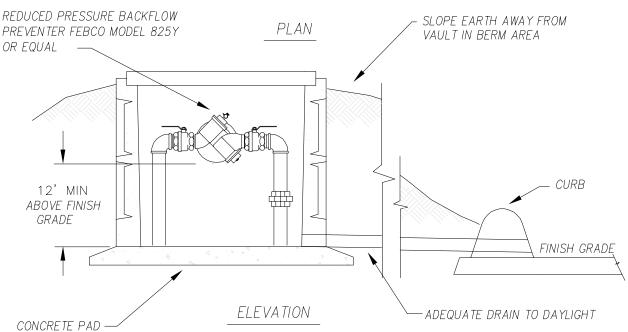

INSTALLATION SHOWN IS ONLY A SUGGESTION.

- 1. DOUBLE CHECK TO BE LOCATED DIRECTLY BEHIND WATER METER.
- 2. BRASS, STAINLESS, OR PLASTIC PLUGS TO BE INSTALLED IN TEST COCKS IF BELOW GROUND INSTALLATION.
- 3. DISTANCE FROM BOTTOM OF DEVICE TO FINISH GRADE, FREEZE PROTECTION, AND CLEARENCE FOR TESTING AND REPAIR ARE THE MAJOR CONSIDERATIONS FOR INSTALLATION.

LAKE GROVE WATER DISTRICT WATER SYSTEM STANDARDS

NOVEMBER, 1998

REDUCED PRESSURE BACKFLOW ASSEMBLY