

**RESOLUTION NO. 97-013**

**A RESOLUTION ADOPTING LOCAL LIMITS FOR  
DISCHARGE TO THE CITY WASTEWATER SYSTEM.**

**WHEREAS**, the Federal Water Pollution Control Act (Clean Water Act) requires The United States Environmental Protection Agency to develop pretreatment standards designed to prevent the discharge to Publicly Owned Treatment Works (POTWs) of pollutants "which interfere with, pass-through, or are otherwise incompatible with such works"; and

**WHEREAS**, USEPA has developed the General Pretreatment Regulations (40 CFR Part 403) to implement the requirements of Section 402 of the amended Clean Water Act, establish general and specific prohibitions, and require the development of specific local limits (numerical standards under 40 CFR 403.5); and


**WHEREAS**, the Oregon Department of Environmental Quality has, through a Permit Action Letter dated September 22, 1994 which amends NPDES Permit No. 101120, required that the City perform a technical local limits evaluation and adopt local limits upon review and approval by DEQ; and

**WHEREAS**, OMI, Inc., under contract with the City, has performed the local limits evaluation by approved EPA methods, and the resulting local limits have been reviewed and approved by DEQ; and

**WHEREAS**, the City Council has adopted General Ordinance No. 96-1205, establishing a Pretreatment Program; and

**WHEREAS**, Section 2.4 of General Ordinance No. 96-1205 provides for adoption of local limits by resolution;

**NOW, THEREFORE, BE IT RESOLVED BY THE CITY COUNCIL AS  
FOLLOWS:**




Section 1. That the following technically-based local limits be established to govern all discharges to the City wastewater system:

PARAMETER	LIMIT
Arsenic	0.67 mg/L
Cadmium	0.55 mg/L
Chromium	2.77 mg/L
Copper	3.38 mg/L
Cyanide	1.20 mg/L
Lead	0.69 mg/L
Mercury	0.0035 mg/L
Nickel	3.98 mg/L
Pentachlorophenol	1.21 mg/L
Silver	0.10 mg/L
Zinc	2.61 mg/L
Fats, Oil, & Grease	100 mg/L
pH	6.0 - 9.0
Temperature	104 <sup>0</sup> F      At entrance to plant 150 <sup>0</sup> F      Discharge to collection system
Flammability	9 minutes/day at 5% LEL, and no reading of 10% LEL allowed

**PASSED AND ADOPTED THIS 10TH DAY OF MARCH, 1997**


Voting Yes, Councilors: Gosiak, McFadden, Davis, Van Cleave  
Voting No, Councilors: None  
Absent, Councilors: Hill  
Abstaining, Councilors: None

**AND APPROVED BY THE MAYOR THIS 10TH DAY OF MARCH, 1997**

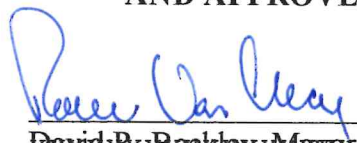

~~David R. Beckley, Mayor~~

Robb Van Cleave, Mayor protem



ATTEST:

Julie Krueger, CMC, City Clerk