



**a) Annual Release Detection Operability Testing** (Sometimes referred to as Tank Gauge Certification)

Date of last testing: \_\_\_\_\_ Last three tests available?  Yes  No

**b) Piping Release Detection** (Check all that apply)

Pressurized Piping

Mechanical Leak Detector (MLLD)  Electronic Leak Detector (ELLD) - check for swiftcheck requirement

Date of last testing: \_\_\_\_\_ Last three tests available?  Yes  No

Number of lines tested: \_\_\_\_\_ Number of LD tested: \_\_\_\_\_

Leak detector manufacturer make and model: \_\_\_\_\_

Tank gauge manufacturer make and model: \_\_\_\_\_

MLLD on turbine manifold?  Yes  No

MLLD product appropriate? (Example, diesel Red Jacket FX series on diesel system?)  Yes  No

If ELLD and no line testing: Annual 0.1 gph results from tank gauge?  Yes  No

Interstitial Monitoring

[Monthly records must include, date system was checked, observations made, initials of person checking. Electronic records must include power status (on or off), alarm indication status (yes or no) and sensor malfunction notes (yes or no).]

Date of last sump testing: \_\_\_\_\_ Last two tests available?  Yes  No

Date of last sensor testing: \_\_\_\_\_ Last three tests available?  Yes  No

Float sensors installed correctly?  Yes  No

Interstitial space opened to sump?  Yes  No

Presence of water in sumps?  Yes  No

Safe Suction

Check valve directly below suction pump?  Yes  No

**c) Monthly Tank Release Detection** (Check all that apply)

Tank Gauge  CSLD  SCALD  Static

Are correct tank sizes programmed at tank gauge?  Yes  No

Tank diameter/length seem appropriate?  Yes  No

Are tanks manifolded?  Yes  No

If so, tank gauge testing setup for manifolded tanks?  Yes  No

*If Veeder Root tank gauge leak detection*  
 CSLD set at 99%  
 Thermal coefficient set correctly?  
 (Gasoline 0.00070; Diesel 0.00045)  
*If Incon/Franklin tank gauge leak detection*  
 If SCALD is Vol Qual set to 14% (or 99% confidence)  
 Is API gravity set correctly?  
 (Regular 63.5; Plus 62.8; Super 51.3; Diesel 32.8)  
 For all tank gauges doing static tests  
 (Static tests require tank to be 50% full for a valid test)

Interstitial Monitoring [Monthly records must include, date system was checked, observations made, initials of person checking.

Electronic records must include power status (on or off), alarm indication status (yes or no) and sensor malfunction notes (yes or no).]

SIR Ensure pass or fail results within 30-day period. Inconclusive result means release detection requirement not met

Tank release detection records available during inspection

T1:  Jan  Feb  Mar  Apr  May  Jun  Jul  Aug  Sep  Oct  Nov  Dec  
 T2:  Jan  Feb  Mar  Apr  May  Jun  Jul  Aug  Sep  Oct  Nov  Dec  
 T3:  Jan  Feb  Mar  Apr  May  Jun  Jul  Aug  Sep  Oct  Nov  Dec  
 T4:  Jan  Feb  Mar  Apr  May  Jun  Jul  Aug  Sep  Oct  Nov  Dec  
 T5:  Jan  Feb  Mar  Apr  May  Jun  Jul  Aug  Sep  Oct  Nov  Dec

**VIII. Spill Prevention** **Compliance**  Yes  No

Date(s) of testing: \_\_\_\_\_ Number of spill buckets tested? \_\_\_\_\_

Did spill bucket pass most recent testing?  Yes  No If no, was spill bucket replaced/repaired?  Yes  No

During inspection, visual damage to spill bucket?  Yes  No

Hydrostatic testing (test takes one hour to complete)

Vacuum test (test takes 1 minute, ending vacuum must be 26 inches water column or greater)

**IX. Overfill Prevention** **Compliance**  Yes  No

Date(s) of testing: \_\_\_\_\_

Overfill device pass most recent testing?  Yes  No If no, overfill device replaced?  Yes  No

Overfill method that was tested:  Alarm  Flapper  Ball Float

Overfill Alarm

Alarm sounds when tank is 90% full  Yes  No

Driver can see or hear alarm at point of transfer?  Yes  No

Sound alarm from tank gauge during inspection?  Yes  No

Flapper Valve

Testing verified the valve automatically restricts flow at 95%  Yes  No

Visual observation of flapper on day of inspection?  Yes  No

Ball Float

Testing verified the ball float automatically restricts flow at 90%  Yes  No

Visual observation of ball float during inspection?  Yes  No

**X. Corrosion Protection** **Compliance**  Yes  No

Cathodic  Galvanic  Impressed Current

Steel tank with cathodic?  Yes  No

Steel pipes with cathodic?  Yes  No

Steel flex-lines with cathodic?  Yes  No

Date of cathodic test: \_\_\_\_\_

Last two tests available?  Yes  No

Did last test pass?  Yes  No

If not:

Was failed test reported to DEQ?  Yes  No

Was system repaired?  Yes  No

Date of repair? \_\_\_\_\_

Cathodic retested within 6 mos. of repair?  Yes  No

Date of retesting? \_\_\_\_\_

If impressed current system:

Rectifier Operational?  Yes  No

Rectifier log maintained?  Yes  No

Rectifier been operating continuously  Yes  No

Tank Lining

Date of last test? \_\_\_\_\_

Pressure test conducted after tank lining inspection?  Yes  No

**XI. General notes from inspection**

Representative onsite: \_\_\_\_\_ email: \_\_\_\_\_

Compliance Determination:     No Violations Observed     Observed violations resulting in enforcement

Inspector Signature: \_\_\_\_\_ Date: \_\_\_\_\_

# UST Inspection Survey

Submitted by: blakely.gilbert\_deq

Submitted time: Jan 7, 2026, 1:02:05 PM

Date

**Jan 7, 2026**

Time

**08:00**

UST Facility ID

**1,355**

Inspector


**Gilbert**

Type of Inspection

**Full Compliance**

Location




**Lat: 45.859903 Lon: -122.820842**

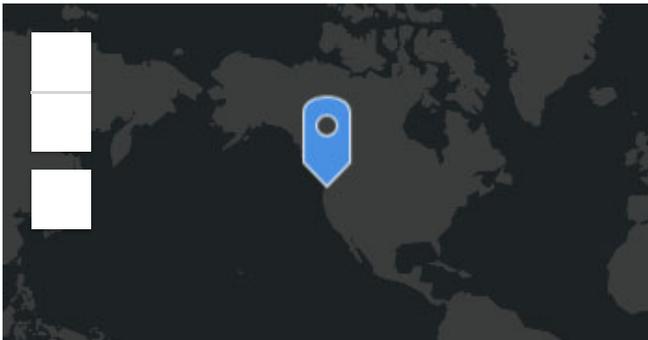


Esri, FAO, NOAA, USGS

Powered by Esri




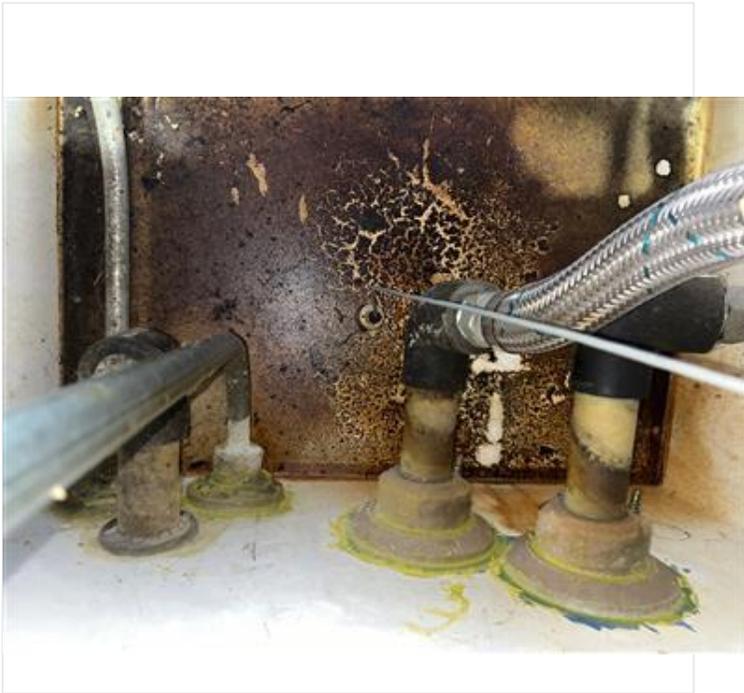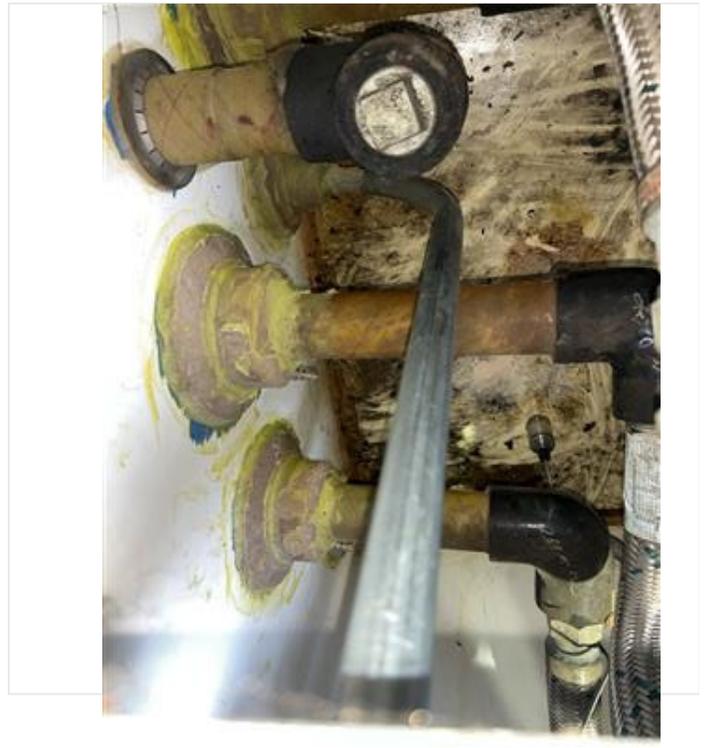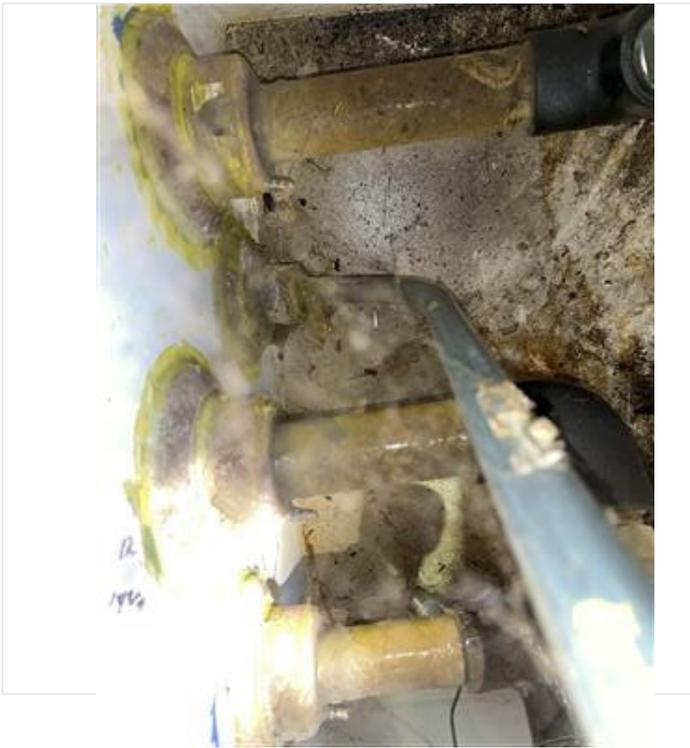

photos-20260107-171017.jpg

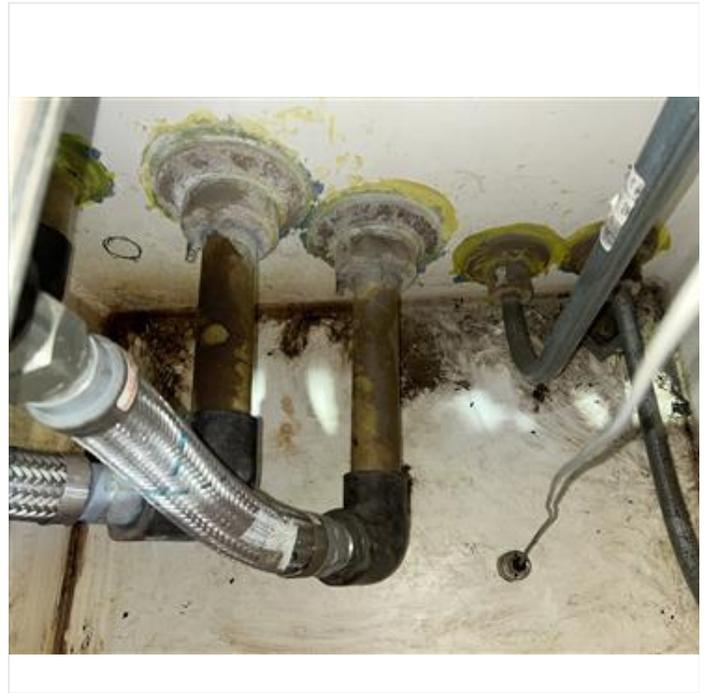

photos-20260107-170920.jpg

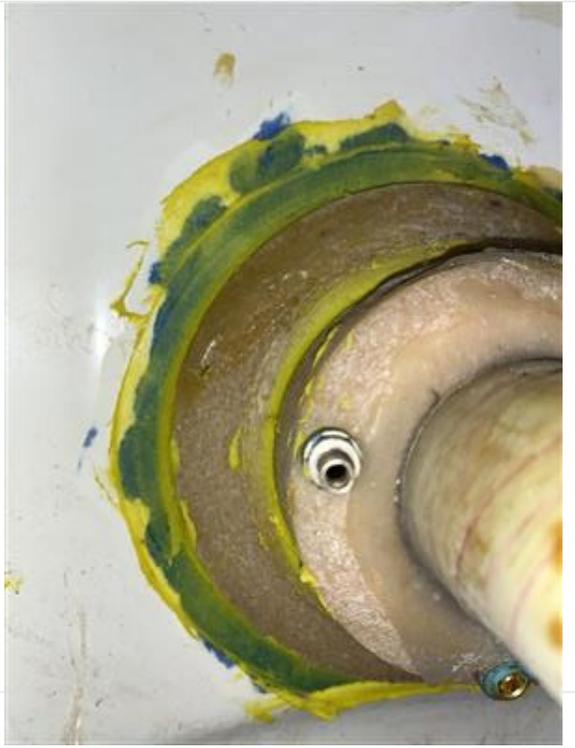

photos-20260107-170650.jpg



photos-20260107-165550.jpg



photos-20260107-165203.jpg

**Oregon**  
 Division of Environmental Quality  
 800 NE Oregon Street, Salem, OR 97331  
 Phone: 503-326-6000 Fax: 503-326-6001  
 TDD: 503-326-6002  
 Oregon State Police, 1000 NE Oregon Street, Salem, OR 97331  
 Phone: 503-326-6000 Fax: 503-326-6001

**Storage Tank Program Report**

Inspector: Mark Olson Date: 01/07/25 Time: 9:00am Facility: 1385

**Site Information**

Facility Name:	SANT HELENS CHEVRON	Appliance:	ZAMBONIA	Service:	360-431-4330
Site Address:	115 N HWY 30	Inspector:	COLEMAN	Phone:	360-660-4907
City:	SANT HELENS, OR 97051	Phone:			

**Site Information**

Color Number:	BOYRG	BOYMH	BOYKJ		
Estimated Volume:	10000	8000	8000		
Substance:	GAS	GAS	GAS		
Tank Material:	COMPOSITE	STEEL WITH	FIBERGLASS		
Tank Install Date:	1990	1993	1993		
Class Material:	FLEX PLASTIC	FLEX PLASTIC	FLEX PLASTIC		
Press Type:	DW PRESSUR	DW PRESSUR	DW PRESSUR		
Press Install Date:	2019	2019	2019	INTERSTITIAL	MONITORING
Overfill Device:	ALARM	ALARM	ALARM		

Notes and Comments from the UST database:  
 Tank name 2 has 3 JTS, 4 HOC - all good.

Z.JONES@WILCOXANDFIEGEL.COM  
 3/2019-

**Operating Certificate**

Compliance:  Yes  No

**Operator Information**

Class A/B Operator:  Yes  No Name: Zachary Jones Date: 5-27-2022

Class C Operator:  Yes  No  Transfer

**Operational Requirements**

Compliance:  Yes  No


Type of coverage: 24 HOURS Begin Date: 3-1-25 End Date: 3-1-26  
 Coverage amount covered: 3 Number of tanks covered: 3

**Walkthrough Requirements**

Compliance:  Yes  No

Spill prevention and release detection equipment checked monthly?  Yes  No  
 Tank top covers checked annually?  Yes  No

Page 1 of 4

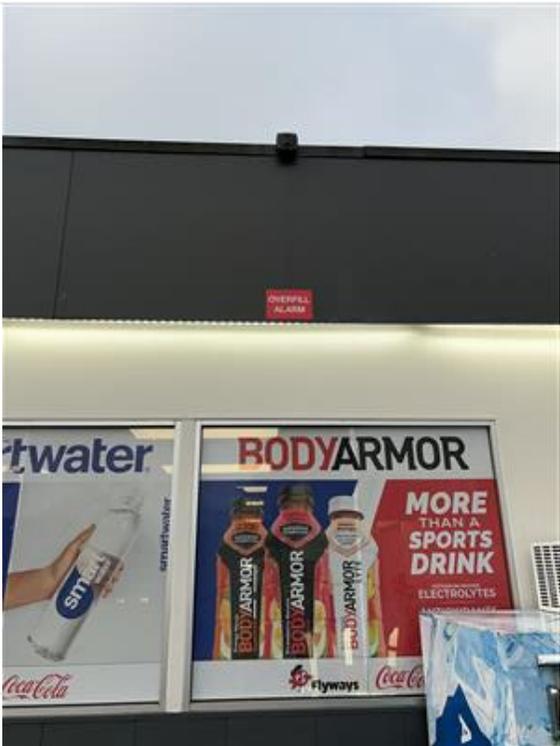





Program Enforcement No. 2026-FC-10090

This section for DEQ use only

State of Oregon  
Department of  
Environmental  
Quality

Department of Environmental Quality  
Underground Storage Tank Program

Field Citation  
For UST Violations

Page 1 of 3

DEQ Information		UST Facility Information	
Inspection Date:	01/09/2026	Facility ID#:	1355
Inspector:	Blakely GILBERT	Facility Name:	ST HELENS CHEVRON
DEQ Office:	700 NE Multnomah St Suite 600 FLR # 14	Facility Address:	115 N HWY 30, SAINT HELENS, Oregon 97051
Phone #:	503-360-4408	County:	Columbia

Oregon DEQ inspected the facility listed above and identified the UST violations listed on page 3 of this Field Citation.

Field Citation Issued:	<input type="checkbox"/> In Person	<input checked="" type="checkbox"/> By Email	<input type="checkbox"/> Both	Date Issued: 01/13/2026
Facility Representative Present During Inspection:	<input type="checkbox"/> Permittee <input type="checkbox"/> Owner <input type="checkbox"/> Other			
Name of Permittee or Owner:	Wilson Oil, Inc.			
Mailing Address:	PO Box 69 , Longview Washington 98632			
Field Citation Penalty – See Page 3 for a detailed listing of each violation.				\$ 150

**Check payable to: DEQ Financial Services LBX3615; P.O. Box 3615; Portland OR 97208-3615**

**Or pay online through your YDO account**

**This Field Citation is issued in accordance with the requirements for the expedited enforcement of Underground Storage Tank (UST) violations, OAR 340-150-0250.**

**Owner or Permittee should select Option 1 or Option 2 below and return a signed copy of this form to DEQ by the following date: 02/13/2026**

DEQ Revenue Section  
700 NE Multnomah St. #600  
Portland, Oregon 97232

**Check one option**

- Option 1** - I acknowledge that the listed violation(s) have occurred, and I am remitting the listed field citation penalty.
- Option 2** - I do not want to participate in the expedited enforcement process and understand that my file will be referred to the Department's Office of Compliance and Enforcement for formal enforcement action.

Name:	Owner / Permittee
Signature:	Date:

**Important**

**Read pages 2 and 3 for more information about your options and a detailed listing of violations and compliance requirements.**

## **Field Citation Requirements**

The permittee or owner should select Option 1 or Option 2 and return a signed copy of Page 1 of the Field Citation form within thirty (30) days of issuance of the Field Citation. If the permittee or owner fails to sign and send Page 1 of the Field Citation form back or pay the penalty within thirty days, Option 1 expires, the Field Citation will serve as a Pre-Enforcement Notice (PEN) and the permittee and owner will be subject to formal enforcement, including the imposition of civil penalties in accordance with OAR Chapter 340, Division 12.

The permittee or owner must complete the actions required to correct the violations listed on the Field Citation by the date specified to prevent further enforcement action by DEQ.

### **Option 1:**

By checking Option 1, the permittee or owner acknowledges that the violations listed on Page 3 of this Field Citation have occurred and agrees to pay the established penalty.

By submitting payment of the penalty amount, the responding permittee or owner agrees to accept the field citation as a final order of the Environmental Quality Commission (commission) and waives any and all rights and objections to the form, content, manner of service and timeliness of the Field Citation; to a contested case hearing and judicial review of the Field Citation [OAR 340-150-0250(6)]; and to service of a copy of this Final Order (*i.e.*, no other copy will be provided).

Upon the Department's receipt of payment of the penalty amount set forth in the Field Citation, the Field Citation becomes a Final Order of the Commission that:

1. Imposes upon the permittee or owner a civil penalty in the amount listed on Page 1 of this Field Citation; and
2. Requires the permittee or owner to satisfactorily complete the requirements and actions necessary to correct the violations documented by the dates set forth on Page 3 of this Field Citation.

Failure by the permittee or owner to complete the actions set forth on Page 3 of the Field Citation by the specified date violates the Commission Order and subjects the permittee and owner to a formal enforcement action, including the imposition of additional civil penalties.

### **Option 2:**

The permittee or owner may deny that the violations as listed on Page 3 of this Field Citation have occurred or contest the Field Citation process by checking Option 2 and submitting to the Department a signed copy of Page 1 of the Field Citation. In that event, the Field Citation will serve as a Pre-Enforcement Notice (PEN) and the permittee and owner will be subject to formal enforcement for those violations set forth in the Field Citation, including the imposition of civil penalties in accordance with OAR Chapter 340, Division 12. Civil penalties that will be imposed by the formal enforcement process will exceed the Field Citation penalties for the same violation(s).

**The Department appreciates your cooperation and efforts to comply with the regulations for underground storage tank systems.**

**UST FIELD CITATION**

**DATE ISSUED: 01/13/2026**

**PROGRAM ENFORCEMENT No.: 2026-FC-10090**

**FACILITY ID: 1355**

**Page 3 of 3**

<b>Violation #1:</b> <b>*TCR:</b>	<b>(A15) Failure to conduct monthly periodic operation and maintenance walkthrough inspection by 10/01/20 and each month thereafter.</b>		
Corrective Action:	complete monthly walkthrough inspection within 30 days.		
Rule Citation: <b>OAR 340-150-0315(1)(a)(A)</b>	Penalty Amount: \$ 150	Correct Violation by: 02/13/2026	Date Violation Corrected:
<b>Violation #2:</b> <b>*TCR:</b>			
Corrective Action:			
Rule Citation: <b>OAR</b>	Penalty Amount: \$	Correct Violation by:	Date Violation Corrected:
<b>Violation #3:</b> <b>*TCR:</b>			
Corrective Action:			
Rule Citation: <b>OAR</b>	Penalty Amount: \$	Correct Violation by:	Date Violation Corrected:
<b>Violation #4:</b> <b>*TCR:</b>			
Corrective Action:			
Rule Citation: <b>OAR</b>	Penalty Amount: \$	Correct Violation by:	Date Violation Corrected:
<b>Violation #5:</b> <b>*TCR:</b>			
Corrective Action:			
Rule Citation: <b>OAR</b>	Penalty Amount: \$	Correct Violation by:	Date Violation Corrected:
<b>Violation #6:</b> <b>*TCR:</b>			
Corrective Action:			
Rule Citation: <b>OAR</b>	Penalty Amount: \$	Correct Violation by:	Date Violation Corrected:

Total Penalty Amount: \$ **150**

**YOU MUST CORRECT THE VIOLATIONS AS REQUIRED, ENTER THE DATES CORRECTED, SIGN THE STATEMENT BELOW, AND**

**RETURN THIS FORM TO THE DEQ INSPECTOR LISTED ON PAGE 1 ON OR BEFORE: 02/13/2026**

**Retain a copy of this form and all documentation of corrective actions for your records.**

*I hereby certify that the UST violations noted above have been corrected:* \_\_\_\_\_ / \_\_\_\_\_

*Permittee/Owner Signature*

*Date*

---

**Re: DEQ UST # 1355 St Helens Chevron determination notice**

---

**From** LITKE Emily \* DEQ <Emily.LITKE@deq.oregon.gov>  
**Date** Thu 2/12/2026 2:25 PM  
**To** UST Duty Officer \* DEQ <UST.DutyOfficer@DEQ.oregon.gov>  
**Cc** zColeman@wilcoxandflegel.com <zcoleman@wilcoxandflegel.com>

Good afternoon,

I see that payment of the penalty was processed on 1/20/26 - thank you.

The UST inspection for facility 1355 St Helens Chevron located at 115 N Columbia River Hwy St. Helens, OR is **officially CLOSED and COMPLETE.**

As a reminder, its important to maintain documentation for your monthly walkthrough inspections. The DEQ will see you in 3 years (2029) for the next UST inspection.



**Emily Litke** (she/her)  
Duty Officer, Underground Storage Tanks  
DEQ Headquarters, Land Quality Division  
700 NE Multnomah Street, Suite 600  
Portland OR 97232-4100  
503-806-9516  
[Emily.LITKE@deq.oregon.gov](mailto:Emily.LITKE@deq.oregon.gov)

---

**From:** UST Duty Officer \* DEQ <UST.DutyOfficer@DEQ.oregon.gov>  
**Sent:** Tuesday, January 13, 2026 9:19 AM  
**To:** UST Duty Officer \* DEQ <UST.DutyOfficer@DEQ.oregon.gov>  
**Cc:** zColeman@wilcoxandflegel.com <zcoleman@wilcoxandflegel.com>  
**Subject:** Re: DEQ UST # 1355 St Helens Chevron determination notice

Good morning,  
UST facility 1355 St Helens Chevron located at 115 N Hwy 30 Saint Helens, OR

Please review the attached field citation. **The deadline for payment of the \$150 penalty and completion of one month of monthly walkthrough is 2/13/26.**

**Payment of Field Citation Penalty Instructions**

Payment can be made either through **check** or **online** through Your DEQ Online – follow the link below to create an account.

[Getting Started with Your DEQ Online](#) - link to create account and how-to tutorials

[PaymentsforEEOs.pdf](#) – step by step instructions for submitting payments online



**Emily Litke** (she/her)

Duty Officer, Underground Storage Tanks  
DEQ Headquarters, Land Quality Division  
700 NE Multnomah Street, Suite 600  
Portland OR 97232-4100  
503-806-9516  
[Emily.LITKE@deq.oregon.gov](mailto:Emily.LITKE@deq.oregon.gov)

---

**From:** UST Duty Officer \* DEQ <UST.DutyOfficer@DEQ.oregon.gov>  
**Sent:** Friday, January 9, 2026 5:50 PM  
**To:** UST Duty Officer \* DEQ <UST.DutyOfficer@DEQ.oregon.gov>  
**Cc:** zColeman@wilcoxandflegel.com <zcoleman@wilcoxandflegel.com>  
**Subject:** DEQ UST # 1355 St Helens Chevron determination notice

Zabrinna Colman,

I want to thank you for having your service provider meet me at the St Helens Chevron located at 115 N Hwy 30 St Helens DEQ UST # 1355. There was one violation for missing 3 months of walk throughs without the last two consecutive months.

DEQ observed violation, enforcement will be issued per the enforcement guidance. Below are the listed violations.

You will receive the enforcement documentation via a separate email from the UST Duty officer email. The payment can be made via [Your DEQ Online Website](#).

**\*Please email the UST duty officer with all communications about the violation or when sending over the final testing records and any repair documentation. DO NOT SEND THEM TO ME. Contact the UST Duty Officer at 503-229-5034 or [ust.dutyofficer@deq.oregon.gov](mailto:ust.dutyofficer@deq.oregon.gov)**

**Violations:**

1. A15. Failure to conduct monthly periodic operation and maintenance walkthrough inspections by 10/01/2020 and each month thereafter 340-150-0315(1)(a) Class 2  
\*Due to not missing March, April, and Novembers Monthly Walkthroughs.

**Corrective Actions:**

1. Complete Monthly walkthrough inspection within 30 days. Submit compliance certification statement.



**Blake Gilbert** (he/him)

Inspector, Underground Storage Tanks  
DEQ Headquarters, Land Quality Division  
700 NE Multnomah Street, Suite 600  
Portland OR 97232-4100  
C 503-360-4408

Fee	-	Paid	=	Due
\$ 150.00		\$ 150.00		\$ 0.00

Penalty

▶ 2026-fc-10090

📍 UST - Field Citation

\$ 150.00

1 Results

⊕ Add Penalty

➡ Send to FIMS

Payment

▼ Credit Card

\$ 150.00

📅 01/30/2026

📅 01/30/2026

📄 DEQEDM000068600

Pay Type

Amount

Credit Card

150

E-Payment Confirmation#

E-Payment Settle Date

DEQEDM000068600

01/30/2026

Ref#

Payment Date

01/30/2026

Comments

(Remaining Length: 4000)

1 Results

Site Info



ST HELENS CHEVRON

📍 115 N Columbia River Hwy, St Helens, OR 97051-1220

📄 SITE 40695 ✓

📄 FIS 250401

📄 dbo.Incident.LustId=5154 UST (1355)

📄 Stationary

Inspection Info

11209 Completed

📄 UST

📄 Full Compliance Inspection (FC) TCR only

📅 Start Date 01/09/2026

📅 End Date 01/09/2026

Created & Updated Info